


อุปกรณ์ชุดโครงยึดอุปกรณ์ PROJECTED BEAM รุ่น BASE FDG ยี่ห้อ NOHMI
"NOHMI" BASE PROJECTED BEAM MODEL BASE FDG

สำหรับติดตั้งบนอุปกรณ์ รุ่น FDGJ



PROJECTED BEAM TYPE SMOKE DETECTOR FDGJ SERIES

CAT. NO. D-F-18901

ARRANGEMENT PLAN FOR DETECTOR INSTALLATION

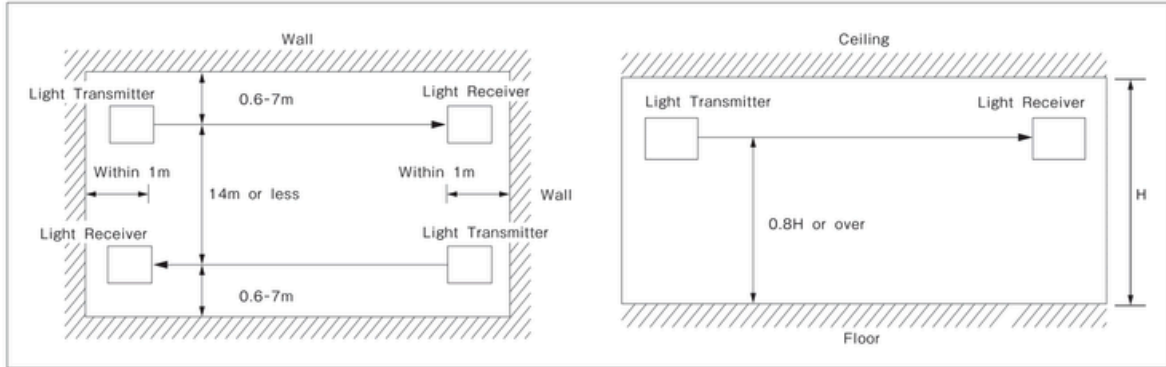

TYPICAL WIRING DIAGRAM(Refer to specification drawing for details.)

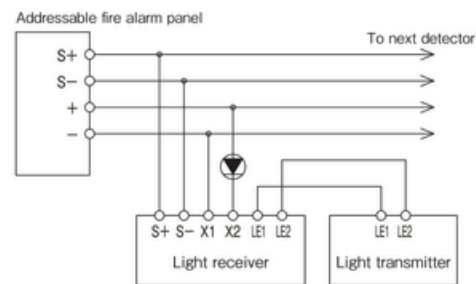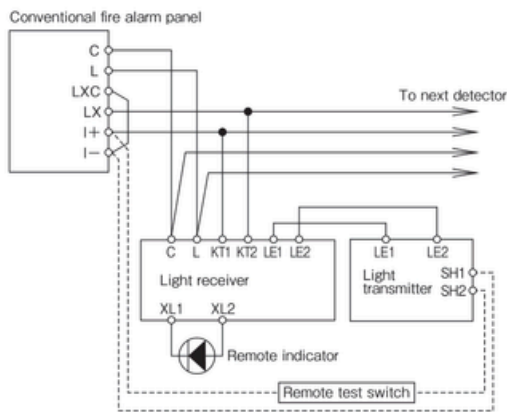

MONITORING DISTANCE V.S. SENSITIVITY

Monitoring distance (m)	Monitoring distance switch setting position	Sensitivity		
		FDGJ103-D-X	FDGJ203-D-X	FDGJ002-D-X
5 to 20	Short	20%	30%	5~45%
20 to 40	Medium	30%	50%	10~60%
40 to 100	Long	50%	70%	20~80%

SUPPLEMENTARY PRODUCT

Description	Model No.	Note
Tool box	FXG012C	Tools for testing and adjustment
Ceiling mounting fixture	ZBD-TS	
Blind cover	ZBDJ001-C	For ZBD-TS
Protection guard	FZP014	For wall mounting
Remote test switch	Surface mtg.	FTC012-1
	Recess mtg.	FTC052-1

NOTE

- The information contained herein does not purport to cover all the details or variations of the equipment described, nor to provide for every possible contingency that may be met in connection with its installation, operation or maintenance.
- Specifications are subject to change without notice. Contact Nohmi before relying on the information.
- Actual performance is based on proper application of the product by a qualified professional.
- Should further information be required or should particular concerns arise that are not covered sufficiently for the purchaser's purposes, the matter should be referred to Nohmi or your nearest distributor.

NOHMI
NOHMI BOSAI LTD.

● HEAD OFFICE : 7-3, Kudan Minami 4-chome,
Chiyoda-ku, Tokyo 102-8277, Japan

● PHONE : (81) 3-3265-0231

● F A X : (81) 3-3265-5348

● U R L : <https://www.nohmi.co.jp/english/>

180810D-F-18901PDF