

**SPECIFICATION**  
**OIL IMMERSED TRANSFORMER**  
**315 KVA. 3 Ph. 50 Hz**  
**33000 - 400 / 230 V.**

**TCT** THAI CENTER TRANSFORMER CO.,LTD  
SPECIFICATION THREE PHASE TRANSFORMER

Address : 67 / 1 Moo. 7 T. Bangkam A. Muang Nakhonpathom 73000

Tel. 081 - 8054856 , 034 - 219036 Fax 034 - 984092 <http://www.thaicentertransformer.com> e - mail : thaicenter671@hotmail.com

**Transformer Specification**

**Quote. Ref :**

**Customer :**

**Project :**

Rated power	.....KVA	<b>315</b>	
Type of transformer	-	Oil immersed ( CONSERVATOR TANK )	
Standard	-	IEC 76	
Cooling System	-	ONAN	
No. Of phase	-	3	
Frequency	.....Hz	50	
Rate of voltage : Primary	.....V.	33000	
: Secondary	.....V.	400/230	
Vector group	-	Dyn 11	
Tapping Type	-	<b>Off Circuit Tap Changer</b>	
No. of steps	-	5	
Percentage of tapping	-	$\pm 2 \times 2.5 \%$	
Impedance voltage at 75 C	.....%	4	
NO - Load current	.....%	1	
Ambient temperature	.....C	40	
Average Temperature rise of winding	.....C	65	
Average Temperature rise of top oil	.....C	60	
Noise level not more than	.....dB	56	
No - Load loss	.....Watt	<b>630</b>	
Load loss at 75 C	.....Watt	<b>3500</b>	
Efficiency at P.F. = 1	: 25 % of rate power	.....%	98.94
	: 50 % of rate power	.....%	98.08
	: 75 % of rate power	.....%	98.79
	: 100 % of rate power	.....%	98.56
Voltage regulation	: at P.F. = 0.8	.....%	3.22
	: at P.F. = 0.9	.....%	2.71
	: at P.F. = 1.	.....%	1.17
Impulse Withstand Voltage	: Primary winding	.....KV.	125
	: Secondary winding	.....KV.	-
Power Frequency	: Primary winding	.....KV.	50
	: Secondary winding	.....KV.	3
Terminal arrangement H.V. Side			Cable
L.V. Side			Cable
Installation on			Pole mounted / Platform

**TCT** THAI CENTER TRANSFORMER CO.,LTD  
**SPECIFICSTION THREE PHASE TRANSFORMER**

Address : 67 / 1 Moo. 7 T. Bangkam A. Maung Nakhonpathom 73000

Tel. 081 - 8054856 , 034 - 219036 Fax 034 - 984092 <http://www.thaicentertransformer.com> e - mail : thaicenter671@hotmail.com



**Transformer Specification**

**Quote. Ref :**

**Customer :**

**Project :**

Rated power	315
Type of transformer	Oil immersed ( CONSERVATOR TANK )
<b>Accessories</b>	
H.V. Bushing with terminal connector	Included
L.V. Bushing with terminal connector	Included
Grounding pad or earth terminal	Included
upper fillter press sampling valve	Included
Oil drain, filter press sampling valve	Included
Name plate	Included
Arcing Horn	Included
Skid Base	Included
Mechanical pressure relief device	Included ( without contact )
Oil level indicator	Included ( with contact )
	Included ( with contact )
	Included ( with contact )
<b>Testing</b>	
<b>- Routine test</b>	
Ratio test at each position of tap	Included
Polarity and phase relation test	Included
Resistance measurement	Included
No - Load loss and exciting current test	Included
Impedance and load loss test	Included
Applied potential test	Included
Induced potential test	Included
Insulation resistance test	Included
Oil test	Included
<b>- Specia test</b>	
Impulse withstand test	Included ( Thaicenter lab )
Temperature rise test	Included ( Thaicenter lab )

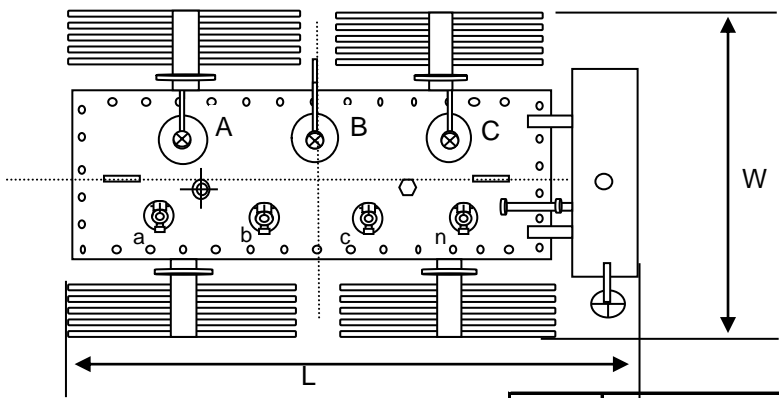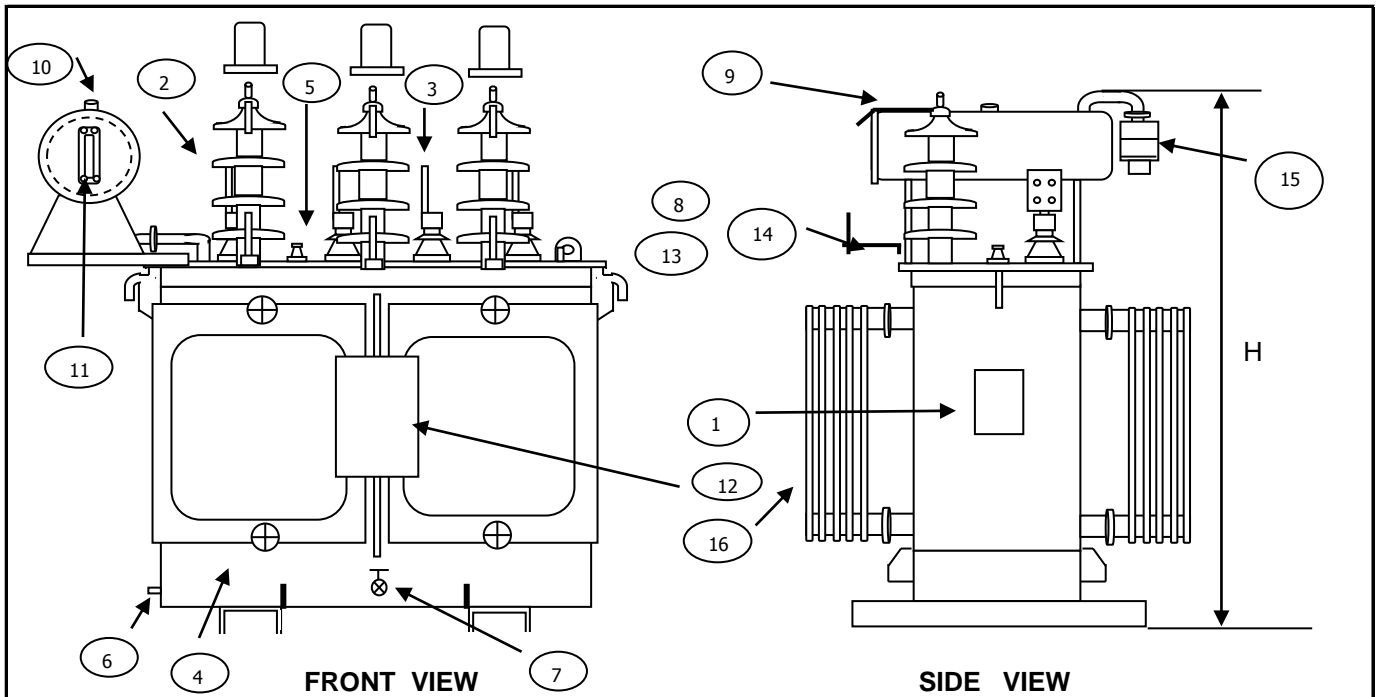

NO	DESCRIPTION	QTY.
1	NAMEPLATE WITH CONNECTION DIAGRAM	1
2	HV. BUSHING W / TERMINAL CONNECTOR	3
3	LV. BUSHING W / TERMINAL CONNECTOR	4
4	TANK	1
5	TAP CHANGE	1
6	EARTH TERMINAL	1
7	OIL DRAIN VALAE	1
8	LIFTING EYES ON THE COVER	2
9	CONSERVATOR TANK	1
10	OIL FILLING CAP	1
11	OIL LEVEL GAUGE	1
12	LOGO	1
13	THERMOMETER POCKET	1
14	ARCING HORN	3
15	DEHYDRATING BREATHER SILICAGEL	1
16	CORRUGATED FIN	1

THAI CENTER TRANSFORMER CO.,LTD					
Dimension in millimetres				Total wt.	Oil
	H	L	W	( Kgs.)	( Litres )
	1530 mm	1400 mm	785 mm	1250	365

DESIGN No.	00315TCT0010052	S/O No.	A100052
------------	-----------------	---------	---------

NAME	TITLE :	OUTLINE DRAWING
DRN.BY		315 kVA. 3 Ph. Dyn11
CHK.BY		33000 - 400 / 230
APP. BY		TYPE : CONSERVATOR TANK

**PRELIMINARY DRAWING**  
 This drawing is for estimation only showing approximate dimensions and should not be used for actual purposes  
 In case of order a definite drawing will be produced for formal approval